

STORMWATER MANAGEMENT SUMMARY REPORT

10 @ 8th STREET APARTMENTS 278 UNION STREET NEW BEDFORD, MASSACHUSETTS

Revised October 25, 2021

Prepared for:

Alinea Capital Partners, LLC 278 Union Street New Bedford, Massachusetts

Prepared by:

Gale Associates, Inc. 163 Libbey Parkway Weymouth, MA 02189 Gale JN 718460



PROJECT DESCRIPTION

Alinea Capital Partners, LLC is proposing to redevelop the property located at 278 Union Street in New Bedford. The site will be redeveloped to include a five-story multi-use building. This report has been prepared to describe the existing and proposed stormwater management on the site.



Existing Conditions

The existing site has a single-story masonry building with a footprint that occupies about one-quarter of the property (approximately 4,000 square feet) and is located on the northern portion of the site. The area to the south of the existing building is impervious parking (approximately 11,320 square feet). The existing building frontage is on Union Street to the north and abuts existing buildings, 282 Union Street to the west and 276 Union Street building to the east. The site is currently 95% impervious, with no stormwater treatment in the parking lot.

According to the USDA Natural Resources Conservation Service (NRCS) Soil Resource Report, the site soils are "Urban Land". The Foundation Engineering Report, dated August 22, 2017 by McPhail

Associates indicates measured groundwater elevations of 75.7 to 80.3 (NGVD) with an average elevation of approximately 77.0.

According to MassGIS, the site is not within a Flood Hazard Zone, not within jurisdictional wetland or river resource areas, not within an Interim Wellhead Protection Area (IPWA) or Zone II well protection zone; and not within mapped National Heritage Endangered Species Habitat.

Proposed Conditions

The proposed development will consist of a 5-story mixed-use (residential and commercial) structure which will include a full below-grade garage and basement and occupy an approximate 15,750 square-foot plan area. The proposed building footprint will occupy the entire site. It is understood that the proposed garage floor slab is planned to be constructed at elevation 82.5, and the basement floor elevation is planned to be constructed at elevation 74.0.

STORMWATER MANAGEMENT

Pre-Development

The site drains from two areas to the municipal system; the parking lot, approximately 12,071 square feet (75%), discharges untreated runoff to a catch basin. The remaining 4,000 square feet (25%) is roof runoff that discharges directly to the municipal system from connected roof leaders.

Area	EWS-1
Total Contributary Area (s.f.)	16,071
Curve Number (CN)	97
Time of Concentration (min)	6.0
Hydrologic Soil Group	Α

Post-Development

After construction, the building lot coverage will be 100%, so site stormwater will be collected entirely from the roof and directed to the municipal stormwater system via directly-connected roof leaders.

Area	EWS-1
Total Contributary Area (s.f.)	16,071
Curve Number (CN)	98
Time of Concentration (min)	6.0
Hydrologic Soil Group	Α

Peak Rate Comparison


Peak rate of runoff for the existing site as well as for the developed site were calculated at 2, 10 and 100-year design storms. The result shows no increase in stormwater runoff:

Recurrence Interval	Pre (cfs)	Post (cfs)
2-year	1.2	1.2
10-year	1.7	1.7
100-year	2.5	2.5

SUMMARY

The proposed project will result in the redevelopment of an existing disused site in an urbanized area that is predominately impervious. Under current conditions, 75% of the existing site discharges untreated roadway/parking lot runoff to the municipal system. Under the developed conditions 100% of the stormwater runoff from the roof will be directly discharged to the municipal system. Roof runoff does not contain vehicular pollutants and sediment from the roadway, and therefore is considered to not contain Total Suspended Solids (TSS), in accordance with the Massachusetts Stormwater Management Standards. Based on this, the project conforms with the City of New Bedford Stormwater Management Rules and Regulations Section 3.2.14.C (June 2021 Revision).

G:\718460 278 Union\02 Design\permit reports\stormwater\Stormwater Report.docx



Site









Prepared by Gale Associates, Inc.

HydroCAD® 10.10-6a s/n 00742 © 2020 HydroCAD Software Solutions LLC

Printed 10/25/2021

Page 2

Rainfall Events Listing (selected events)

Even	t#	Event	Storm Type	Curve	Mode	Duration	B/B	Depth	AMC
		Name				(hours)		(inches)	
	1	2-Year	Type III 24-hr		Default	24.00	1	3.40	2
	2	10-Year	Type III 24-hr		Default	24.00	1	4.80	2
	3	100-Year	Type III 24-hr		Default	24.00	1	7.00	2

Prepared by Gale Associates, Inc.

HydroCAD® 10.10-6a s/n 00742 © 2020 HydroCAD Software Solutions LLC

Printed 10/25/2021

Page 3

Area Listing (all nodes)

Area	CN	Description
(acres))	(subcatchment-numbers)
0.017	86	Newly graded area, HSG B (EX)
0.352	98	Roofs, HSG A (EX)
0.369	97	TOTAL AREA

10 @ 8TH STREET APARTMENTS

278 Union Street Exist

Prepared by Gale Associates, Inc.

HydroCAD® 10.10-6a s/n 00742 © 2020 HydroCAD Software Solutions LLC

Printed 10/25/2021

Page 4

Ground Covers (all nodes)

 HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.017	0.000	0.000	0.000	0.017	Newly graded area	EX
0.352	0.000	0.000	0.000	0.000	0.352	Roofs	EX
0.352	0.017	0.000	0.000	0.000	0.369	TOTAL AREA	

10 @ 8TH STREET APARTMENTS Type III 24-hr 2-Year Rainfall=3.40" Printed 10/25/2021

Prepared by Gale Associates, Inc.

HydroCAD® 10.10-6a s/n 00742 © 2020 HydroCAD Software Solutions LLC

Page 5

Time span=0.00-24.00 hrs, dt=0.05 hrs, 481 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment EX: Site

Runoff Area=16,071 sf 95.33% Impervious Runoff Depth>3.05" Tc=6.0 min CN=97 Runoff=1.17 cfs 0.094 af

Total Runoff Area = 0.369 ac Runoff Volume = 0.094 af Average Runoff Depth = 3.05" 4.67% Pervious = 0.017 ac 95.33% Impervious = 0.352 ac

10 @ 8TH STREET APARTMENTS Type III 24-hr 10-Year Rainfall=4.80" Printed 10/25/2021

Prepared by Gale Associates, Inc.

HydroCAD® 10.10-6a s/n 00742 © 2020 HydroCAD Software Solutions LLC

Page 6

Time span=0.00-24.00 hrs, dt=0.05 hrs, 481 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment EX: Site

Runoff Area=16,071 sf 95.33% Impervious Runoff Depth>4.45" Tc=6.0 min CN=97 Runoff=1.68 cfs 0.137 af

Total Runoff Area = 0.369 ac Runoff Volume = 0.137 af Average Runoff Depth = 4.45" 4.67% Pervious = 0.017 ac 95.33% Impervious = 0.352 ac

10 @ 8TH STREET APARTMENTS Type III 24-hr 100-Year Rainfall=7.00" Printed 10/25/2021

Prepared by Gale Associates, Inc.

HydroCAD® 10.10-6a s/n 00742 © 2020 HydroCAD Software Solutions LLC

Page 7

Time span=0.00-24.00 hrs, dt=0.05 hrs, 481 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment EX: Site

Runoff Area=16,071 sf 95.33% Impervious Runoff Depth>6.64" Tc=6.0 min CN=97 Runoff=2.46 cfs 0.204 af

Total Runoff Area = 0.369 ac Runoff Volume = 0.204 af Average Runoff Depth = 6.64" 4.67% Pervious = 0.017 ac 95.33% Impervious = 0.352 ac

10 @ 8TH STREET APARTMENTS Multi-Event Tables

278 Union Street Exist

Prepared by Gale Associates, Inc.


HydroCAD® 10.10-6a s/n 00742 © 2020 HydroCAD Software Solutions LLC

Page 8

Printed 10/25/2021

Events for Subcatchment EX: Site

Event	Rainfall	Runoff	Volume	Depth
	(inches)	(cfs)	(acre-feet)	(inches)
2-Year	3.40	1.17	0.094	3.05
10-Year	4.80	1.68	0.137	4.45
100-Year	7.00	2.46	0.204	6.64

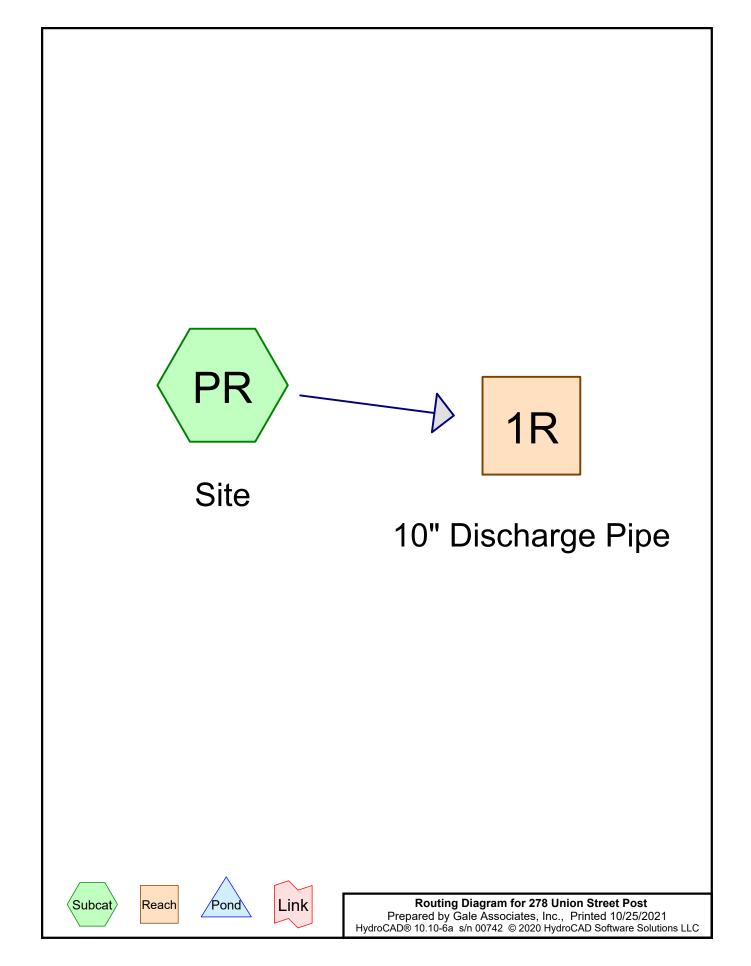

Printed 10/25/2021

Prepared by Gale Associates, Inc.

HydroCAD® 10.10-6a s/n 00742 © 2020 HydroCAD Software Solutions LLC

Page 10

Rainfall Events Listing (selected events)

Even	t#	Event	Storm Type	Curve	Mode	Duration	B/B	Depth	AMC
		Name				(hours)		(inches)	
	1	2-Year	Type III 24-hr		Default	24.00	1	3.40	2
	2	10-Year	Type III 24-hr		Default	24.00	1	4.80	2
	3	100-Year	Type III 24-hr		Default	24.00	1	7.00	2

Prepared by Gale Associates, Inc.

HydroCAD® 10.10-6a s/n 00742 © 2020 HydroCAD Software Solutions LLC

Printed 10/25/2021

Page 11

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
0.369	98	Roofs, HSG A (PR)
0.369	98	TOTAL AREA

10 @ 8TH STREET APARTMENTS

278 Union Street Post

Printed 10/25/2021

Prepared by Gale Associates, Inc.

HydroCAD® 10.10-6a s/n 00742 © 2020 HydroCAD Software Solutions LLC

Page 12

Ground Covers (all nodes)

HSG-A	HSG-B	HSG-C	HSG-D	Other	Total	Ground	Subcatchment
(acres)	(acres)	(acres)	(acres)	(acres)	(acres)	Cover	Numbers
0.369	0.000	0.000	0.000	0.000	0.369	Roofs	PR
0.369	0.000	0.000	0.000	0.000	0.369	TOTAL	
						AREA	

10 @ 8TH STREET APARTMENTS

278 Union Street Post

Prepared by Gale Associates, Inc.

HydroCAD® 10.10-6a s/n 00742 © 2020 HydroCAD Software Solutions LLC

Printed 10/25/2021 Page 13

Pipe Listing (all nodes)

Li	ne#	Node	In-Invert	Out-Invert	Length	Slope	n	Width	Diam/Height	Inside-Fill
		Number	(feet)	(feet)	(feet)	(ft/ft)		(inches)	(inches)	(inches)
	1	1R	74.24	73.76	24.0	0.0200	0.010	0.0	10.0	0.0

10 @ 8TH STREET APARTMENTS Type III 24-hr 2-Year Rainfall=3.40" Printed 10/25/2021

Prepared by Gale Associates, Inc.

HydroCAD® 10.10-6a s/n 00742 © 2020 HydroCAD Software Solutions LLC

Page 14

Time span=0.00-24.00 hrs, dt=0.05 hrs, 481 points Runoff by SCS TR-20 method, UH=SCS, Weighted-CN Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment PR: Site Runoff Area=16,071 sf 100.00% Impervious Runoff Depth>3.16"

Tc=6.0 min CN=98 Runoff=1.19 cfs 0.097 af

Avg. Flow Depth=0.31' Max Vel=6.42 fps Inflow=1.19 cfs 0.097 af Reach 1R: 10" Discharge Pipe 10.0" Round Pipe n=0.010 L=24.0' S=0.0200 '/' Capacity=4.03 cfs Outflow=1.19 cfs 0.097 af

> Total Runoff Area = 0.369 ac Runoff Volume = 0.097 af Average Runoff Depth = 3.16" 0.00% Pervious = 0.000 ac 100.00% Impervious = 0.369 ac

10 @ 8TH STREET APARTMENTS
Type III 24-hr 10-Year Rainfall=4.80"

Prepared by Gale Associates, Inc.

Printed 10/25/2021

HydroCAD® 10.10-6a s/n 00742 © 2020 HydroCAD Software Solutions LLC

Page 15

Time span=0.00-24.00 hrs, dt=0.05 hrs, 481 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment PR: Site Runoff Area=16,071 sf 100.00% Impervious Runoff Depth>4.56"

Tc=6.0 min CN=98 Runoff=1.69 cfs 0.140 af

Reach 1R: 10" Discharge PipeAvg. Flow Depth=0.38' Max Vel=7.05 fps Inflow=1.69 cfs 0.140 af 10.0" Round Pipe n=0.010 L=24.0' S=0.0200'/' Capacity=4.03 cfs Outflow=1.69 cfs 0.140 af

Total Runoff Area = 0.369 ac Runoff Volume = 0.140 af Average Runoff Depth = 4.56" 0.00% Pervious = 0.000 ac 100.00% Impervious = 0.369 ac

10 @ 8TH STREET APARTMENTS Type III 24-hr 100-Year Rainfall=7.00" Printed 10/25/2021

Prepared by Gale Associates, Inc.

HydroCAD® 10.10-6a s/n 00742 © 2020 HydroCAD Software Solutions LLC

Page 16

Time span=0.00-24.00 hrs, dt=0.05 hrs, 481 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment PR: Site Runoff Area=16,071 sf 100.00% Impervious Runoff Depth>6.76"

Tc=6.0 min CN=98 Runoff=2.47 cfs 0.208 af

Reach 1R: 10" Discharge PipeAvg. Flow Depth=0.47' Max Vel=7.75 fps Inflow=2.47 cfs 0.208 af 10.0" Round Pipe n=0.010 L=24.0' S=0.0200 '/' Capacity=4.03 cfs Outflow=2.47 cfs 0.208 af

Total Runoff Area = 0.369 ac Runoff Volume = 0.208 af Average Runoff Depth = 6.76" 0.00% Pervious = 0.000 ac 100.00% Impervious = 0.369 ac

10 @ 8TH STREET APARTMENTS Multi-Event Tables

278 Union Street Post

Prepared by Gale Associates, Inc.

HydroCAD® 10.10-6a s/n 00742 © 2020 HydroCAD Software Solutions LLC

Page 17

Printed 10/25/2021

Events for Subcatchment PR: Site

Event	Rainfall	Runoff	Volume	Depth
	(inches)	(cfs)	(acre-feet)	(inches)
2-Year	3.40	1.19	0.097	3.16
10-Year	4.80	1.69	0.140	4.56
100-Year	7.00	2.47	0.208	6.76

10 @ 8TH STREET APARTMENTS Multi-Event Tables

278 Union Street Post

Prepared by Gale Associates, Inc. HydroCAD® 10.10-6a s/n 00742 © 2020 HydroCAD Software Solutions LLC

Page 18

Printed 10/25/2021

Events for Reach 1R: 10" Discharge Pipe

Event	Inflow	Outflow	Elevation	Storage
	(cfs)	(cfs)	(feet)	(cubic-feet)
2-Year	1.19	1.19	74.55	4
10-Year	1.69	1.69	74.62	6
100-Year	2.47	2.47	74.71	8